




Comparison of "Receiving Well, After Coagulation & Flocculation, After Filtration, Treated Water"

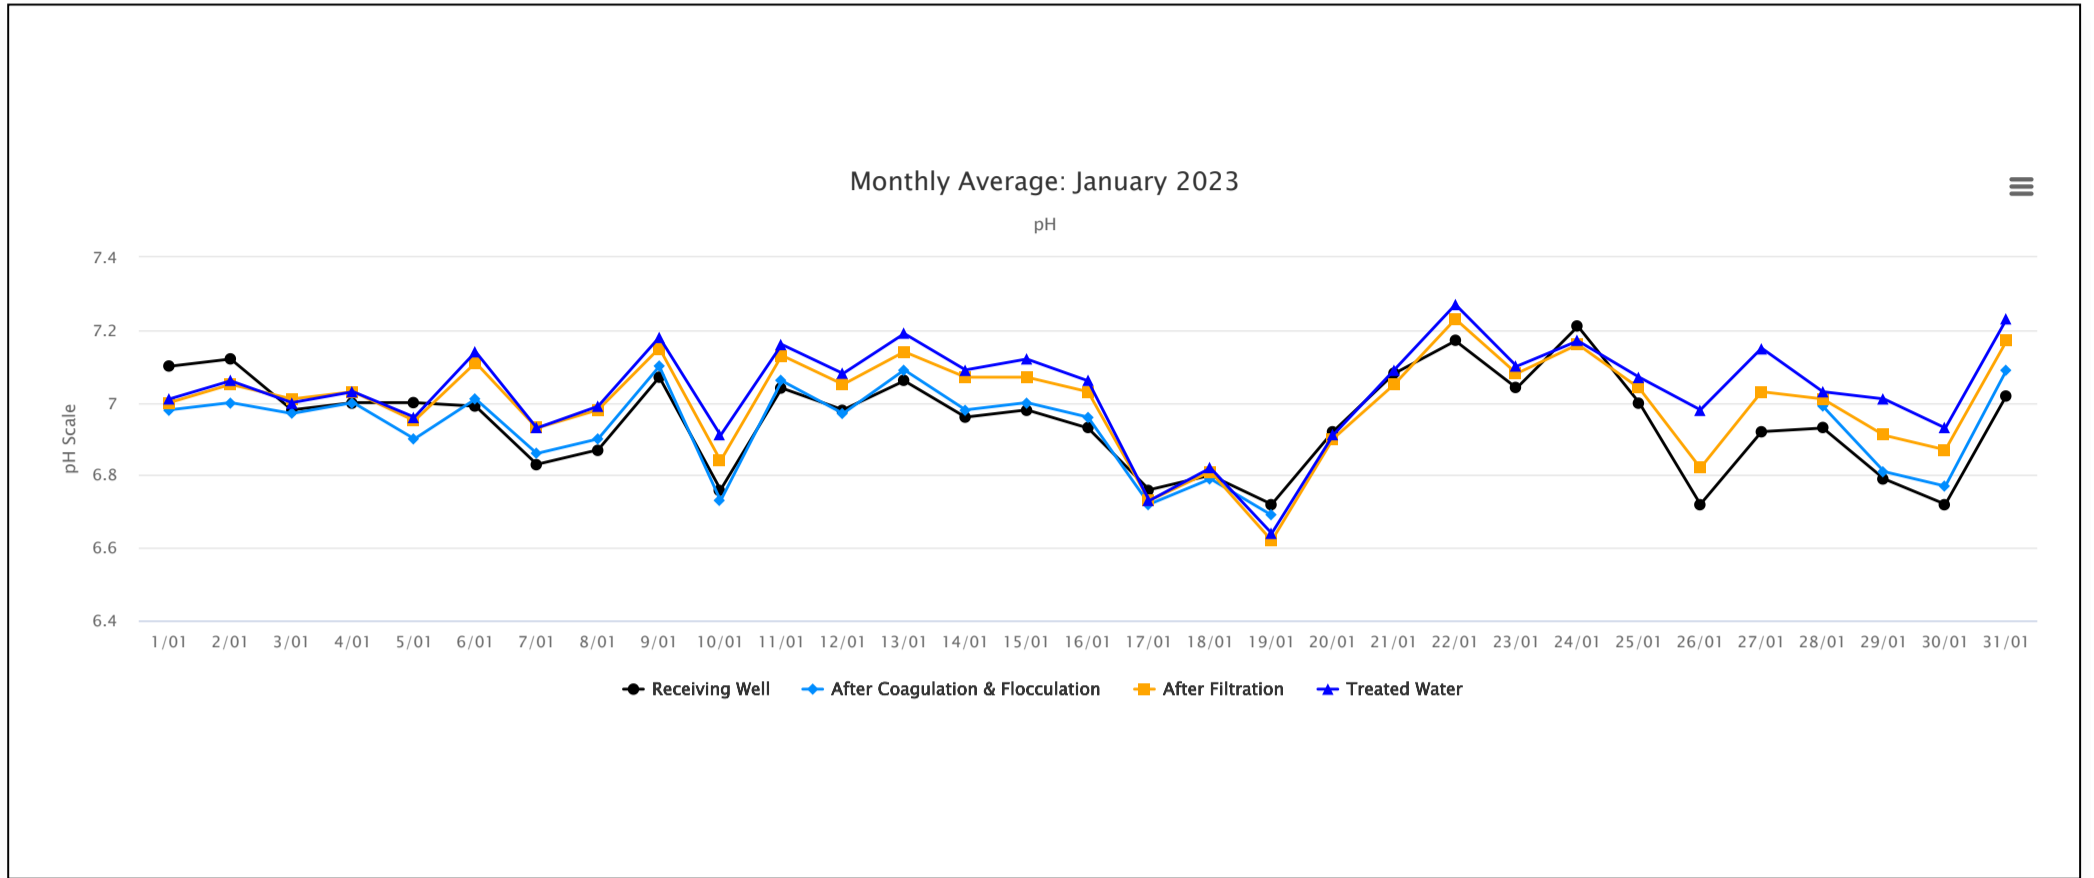

Sample	Unit	Average	Maximum	Minimum
Receiving Well		6.95	7.21	6.72
After Coagulation & Flocculation		6.93	7.10	6.69
After Filtration		7.00	7.23	6.62
Treated Water		7.03	7.27	6.64